



150002281904



(2015)建材质监认字(17)号



中国认可
国际互认
检测
TESTING
CNAS L1449

检 验 报 告

TEST REPORT

报告编号: JC2018HNT1529



样品名称: 水泥基渗透结晶型防水掺合剂

Sample Name

委托单位: 上海美澎材料科技有限公司

Applicant

检验类别: 委托检验 (型式检验)

Test Type

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

National Building Material Industry Enclosure Material and Pipeline Production Quality Supervision and Test Center

检验检测专用章



检验报告 (TEST REPORT)

报告编号№: JC2018HNT1529

第1页, 共2页

委托单位 Applicant	上海美澎材料科技有限公司	检验类别 Test Type	委托检验 (型式检验)
受检单位 Inspected Entity	上海美澎材料科技有限公司	委托日期 Consign Date	2018年10月22日
工程名称及使用部位 Engineering Name and Application Part	—	来样日期 Accept Date	2018年10月22日
样品名称 Sample Name	水泥基渗透结晶型防水掺合剂	样品数量 Sample Quantity	3.5kg
型号/规格 Type/Specification	ECOMIX (803)	样品等级 Grade	—
生产单位 Manufacturer	上海美澎材料科技有限公司	样品状态 Sample State	粉状
生产日期/批号 Production Date/Lot №	—	商标 Trade Mark	—
检验依据 Ref Documents	GB 18445-2012《水泥基渗透结晶型防水材料》		
检验项目 Test Item	外观, 含水率, 细度 (0.63mm筛余), 氯离子含量, 总碱量, 减水率, 含气量, 凝结时间差, 抗压强度比, 收缩率比 (28d), 混凝土抗渗性能		
检验结论 Test Conclusion	该样品经检验, 总碱量、掺防水剂混凝土的抗渗压力 (28d) 和掺防水剂混凝土的第二次抗渗压力 (56d) 检验结果详见数据页; 其它检验项目符合GB 18445-2012《水泥基渗透结晶型防水材料》中水泥基渗透结晶型防水剂的指标要求。 签发日期: 2019年01月08日 (Issued by Stamp)		
附注 Remarks	1. 本检验结果仅对来样负责。 2. 水泥材料用量的1%由委托方提供。 3. 基准混凝土抗渗压力 (28d): 0.3MPa。		

批准: 王周亮
Approved by:审核: 刘禹
Inspected by:主检: 马静
Tested by:

国家建筑材料工业建筑围护材料及管道产品质量监督检验测试中心

检 验 报 告 (TEST REPORT)

报告编号№: JC2018HNT1529

第2页, 共2页

序号	检验项目		标准要求	检验结果	单项判定
1	外观		均匀、无结块	均匀、无结块	符合
2	含水率, %		≤ 1.5	0.9	符合
3	细度 (0.63mm筛余), %		≤ 5	1.02	符合
4	氯离子含量, %		≤ 0.10	0.035	符合
5	总碱量, %		—	7.51	—
6	减水率, %		< 8	3	符合
7	含气量, %		≤ 3.0	1.9	符合
8	凝结时间差	初凝, min	> -90	-10	符合
		终凝, h	—	-0.25	
9	抗压强度比, %	7d	≥ 100	104	符合
		28d	≥ 100	107	
10	收缩率比 (28d), %		≤ 125	104	符合
11	混凝土抗渗性能	掺防水剂混凝土的抗渗压力 (28d), MPa	—	0.6	符合
		抗渗压力比 (28d), %	≥ 200	200	
		掺防水剂混凝土的第二次抗渗压力 (56d), MPa	—	0.7	
		第二次抗渗压力比 (56d), %	≥ 150	175	

检测地址: 北京市石景山区金顶北路69号;
联系电话: 4000330789、010-88724984。

(本页以下空白)

***** 结 束 *****

注意事项

NOTICE

1.报告无“检验检测专用章”或检验单位公章、骑缝章无效。

Test report is invalid without the "special seal for test report" or that of test department and perforated rider stamp on it.

2.复制报告未重新加盖“检验检测专用章”或检验单位公章无效。

Duplication of test report is invalid without the "special seal for test report" or that of test department re-stamped on it.

3.报告无主检、审核、批准签字无效。

Test report is invalid without the signatures of the persons for chief test, verification and approval.

4.报告涂改无效。


Test report is invalid if altered.

5.对检验报告若有异议,应于收到报告之日起十五日内向检验单位提出。

Any dissidence about the test report should be brought forward to the test department within 15 days from the date of receiving the test report.

6.一般情况，委托检验仅对来样负责。

In general, for entrusted tests the responsibilities are undertaken for the delivered samples only.

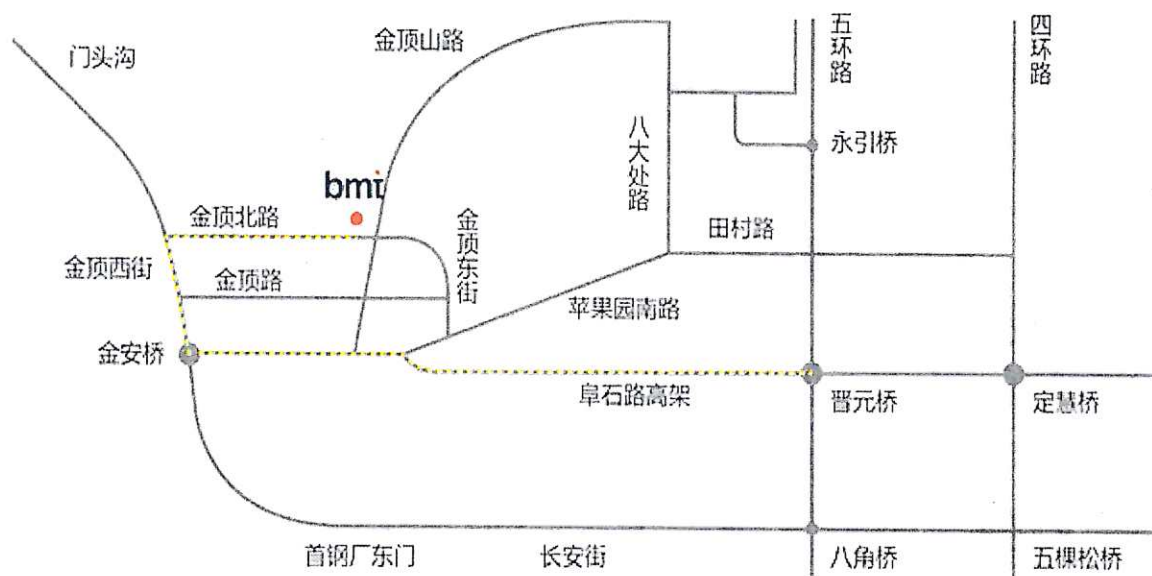

路线备注: 沿阜石路高架向西行驶, 见金顶西街出口进入辅路, 金安桥下右转, 第二个丁字路口 (第一个红绿灯) 右转, 直行 600 米路北。



地址：北京市石景山区金顶北路69号(100041)

Add:No.69 JinDing North Road ,Shijingshan District,Beijing,China 100041

网址(Web) : www.bmtbj.cn

电话(Tel):010-88724984 88749821

传真(Fax):010-88715189

客服热线：400-0330-789